

## PM-2icx Power Monitor - Twin Fan

**PM-icx** unit is our (gas ventilation interlock) fan power monitor for use in the commercial catering sector to meet BS6173:2009.


This product is available in a number of versions, from 1 or 2 fans and 10 to 20 Amp FLC, single and three phase.



Model Type	Model	Description
	<b>PM-2icx</b>	Power Monitor - twin fan

Technical Data		
Power supply		240Vac 50Hz (L,N,& E)
Number of fan channels		Two
Current rating of monitor		10 or 20Amp
Voltage range of fans		Single phase (240Vac) or three phase 415Vac
Gas valve output		240Vac (L,N & E)
Auxiliary output		240Vac (L,N & E) or volt-free

### Typical Application - Supply & Extract Fan Canopy

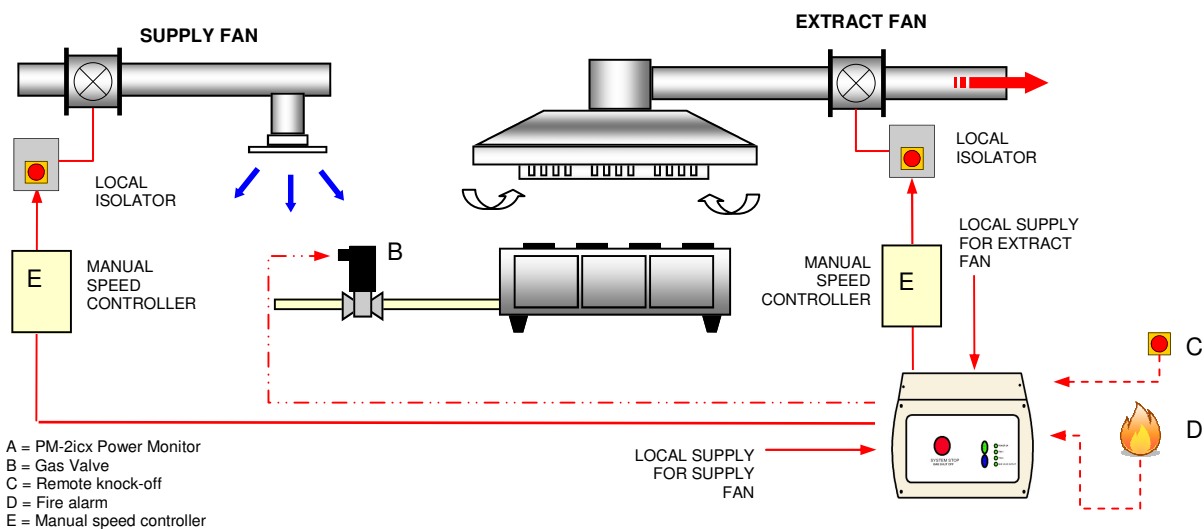


## Wiring Diagram

Terminals T1, T2 & T6 are the smaller terminals (1.5 mm<sup>2</sup> cable) and are used for the inter-locking devices such as "fire alarm" and "remote knock-off units". (Screened cable must be used BELDEN 8723 or equivalent recommended)

Power Terminals are the larger terminals (4 mm<sup>2</sup> cable) and are for the power connections for the fans, gas valve and power supply to the unit.


The terminals are of the rising clamp type with protection.

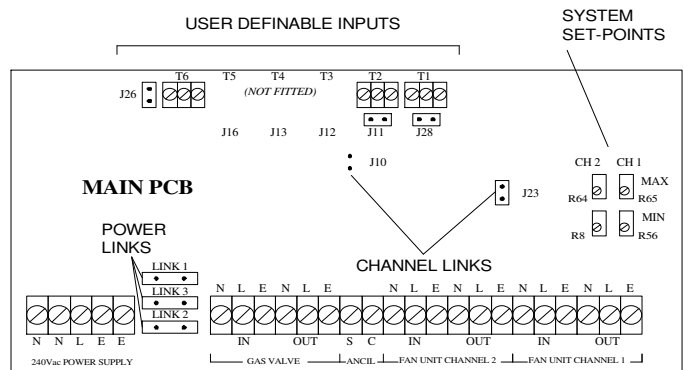

## Fitting Instructions

The **PM-icx** unit has four (4) mounting holes which can be used (as shown)

*Note: Ensure that the enclosure is mounted on a clean and level surface away from the direct cooking area or surfaces.*

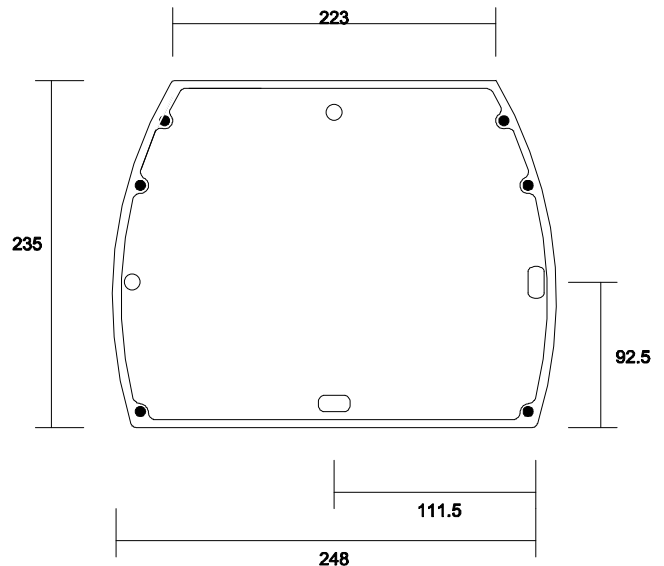

## Ancillary Products

### Remote Knock-off Buttons



RKPB-01 Knock-off

### Key Activation & Shrouds




RKPB-02 Key  
RKPB-03 Key + Shroud

### Gas Valves



GV Valves  
1/2" to 2-1/2" BSP



This symbol on this product or the package indicates that disposal of this product after its lifecycle could harm the environment.  
DO NOT dispose of this product (or batteries if used) as unsorted municipal waste. It should be disposed by a specialised company for recycling.  
This product should be returned to your distributor or to a local recycling service.  
Respect the local environment rules.